


TYPICAL INSTALLATION:
FAILURE TO FOLLOW THESE INSTRUCTION WILL VOID ANY WARRANTY

Local codes shall govern installation requirements. Unless otherwise specified, the installation shall be in accordance with the manufacturer’s instructions and the latest edition of the Uniform Plumbing Code. The installation shall be made so that no part of the unit can be submerged.

		Capacity the Schedule 40 Pipe							
Pipe Size		5 ft/sec	1.52 M/sec	7.5 ft/sec	2.29 M/sec	10 ft/sec	3.05 M/sec	15 ft/sec	4.57 M/sec
3/4"	20 mm	8	30	12	45	17	64	25	94
1"	25 mm	13	49	20	75	27	102	40	151

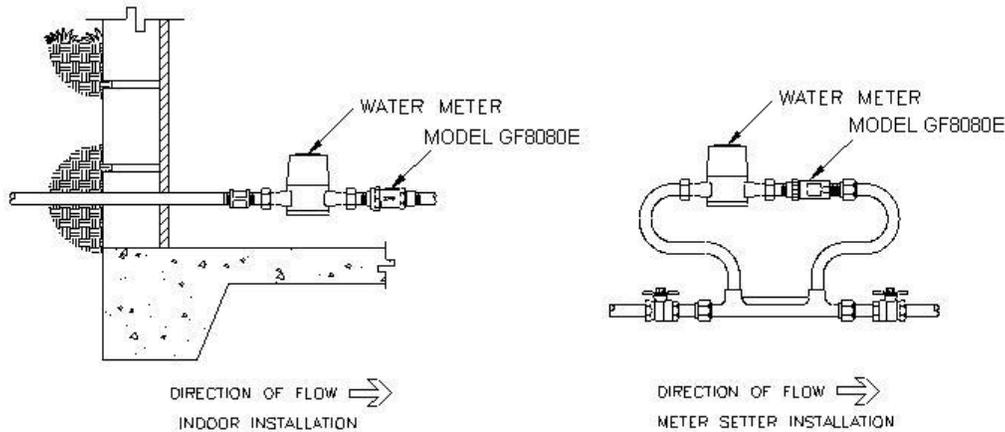

SPECIFICATIONS:

The Dual Check Valve shall be ASSE® Listed 1024. The main body shall be forged brass (ASTM B 124), the check assemblies shall be DELRIN®. The seal ring and o-rings shall be Buna Nitrile. The Dual Check Valve shall be a Glen-Flo™ Model GF8080E.

WARRANTY: Flomatic valves are guaranteed against defects of materials or workmanship when used for the services recommended. If in any recommended service, a defect develops due to material or workmanship, and the device is returned, freight prepaid, to Flomatic Corporation within 12 months from the date of purchase, it will be repaired or replaced free of charge. Flomatic Corporations’ liability shall be limited to our agreement to repair or replace the valve only.